

INSTRUCTIONS FOR WILLIAMS GAS APPLIANCE CONVERSION KIT 8921 & 8922 NATURAL GAS TO LIQUID PROPANE GAS

THIS KIT IS FOR USE WITH MODEL NUMBERS:

4505622 & 6005622

WARNING

This conversion kit shall be installed by a qualified service agency in accordance with the manufacturer's instructions and all applicable codes and requirements of the authority having jurisdiction. If the information in these instructions is not followed exactly, a fire, explosion or production of carbon monoxide may result, causing property damage, personal injury or loss of life. The qualified service agency is responsible for the proper installation of this kit. The installation is not proper and complete until the operation of the converted appliance is checked as specified in the manufacturer's instructions supplied with the kit.

CAUTION: THE GAS SUPPLY SHALL BE SHUTOFF PRIOR TO DISCONNECTING THE ELECTRICAL POWER (IF EQUIPPED WITH BLOWER) BEFORE PROCEEDING WITH THE CONVERSION.

WARNING: IF THE INFORMATION IN THIS MANUAL IS NOT FOLLOWED EXACTLY, A FIRE OR EXPLOSION MAY RESULT CAUSING PROPERTY DAMAGE, PERSONAL INJURY OR LOSS OF LIFE.

THIS CONVERSION KIT IS TO BE USED ON MODEL 4505622; 6005622 MANUFACTURED FOR USE WITH NATURAL GAS AND EQUIPPED WITH GAS VALVE PART NUMBER 6003 ONLY.

P323093 (WALL THERMOSTAT MODEL) ONLY
CONVERTING TO L.P. GAS.

MANUFACTURED FOR:
WILLIAMS FURNACE COMPANY
COLTON, CA. USA (909) 825-0993
6003 LP 10" W.C. MAX. 1/2 P.S.I.
FOR MILLIVOLT SYSTEM ONLY
REPLACEMENT MODEL NO. P323093
MADE IN TAIWAN

WARNING: THE WILLIAMS CONVERSION KIT NUMBERS 6003 CAN ONLY BE USED ON THE MODELS 8921 & 8922 GAS VALVE 6003 AND MUST NOT BE USED ON ANY OTHER BRAND OF GAS VALVE. DO NOT USE THIS CONVERSION KIT ON ROBERTSHAW BRAND GAS VALVES. IF YOU ARE UNABLE TO DETERMINE THE GAS VALVE MODEL NUMBER, DO NOT CONVERT YOUR FURNACE.


THIS KIT CONTAINS:



- (1) PRESSURE REGULATOR
- (1) PILOT ORIFICE (L.P. GAS)
- (1) BURNER ORIFICE (L.P. GAS)
- (2) CONVERSION LABELS
- (2) SCREWS
- (1) L.P.G. TAG

CONVERSION INSTRUCTIONS - NATURAL GAS TO L.P. GAS

1. Shut off gas to the furnace.
2. Disconnect gas supply line from control valve.
3. Disconnect thermostat wires from control valve.
CAUTION: Label all wires prior to disconnection for proper reconnection.
5. Remove burner assembly.
6. Use a boxed end wrench and remove the main burner orifice from the manifold and replace with the orifice provided in this kit. See Fig. below.
7. Remove pilot orifice from pilot and replace with orifice provided in this kit. See Figure 2 on page 2.
8. To replace the pressure regulator on the gas valve, refer to Figure 1 on page 2 for the following steps.
9. Push in gas control knob slightly and turn clockwise to "OFF".
10. Remove (2) screws from the pressure regulator.
11. Lift the pressure regulator and gasket from valve and discard.
12. Install the new gasket, pressure regulator and (2) screws from this conversion kit.
IMPORTANT: Discard old gasket. Do not reuse.
13. IMPORTANT: Check the location of the pilot to the burner. See Figure 4 on page 3.
14. Reassemble the furnace by following Steps 1 thru 5 in reverse order.

4505622 & 6005622 MODEL

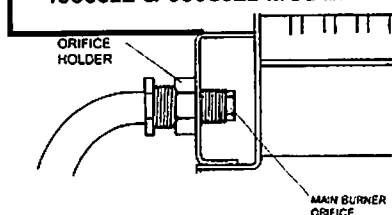

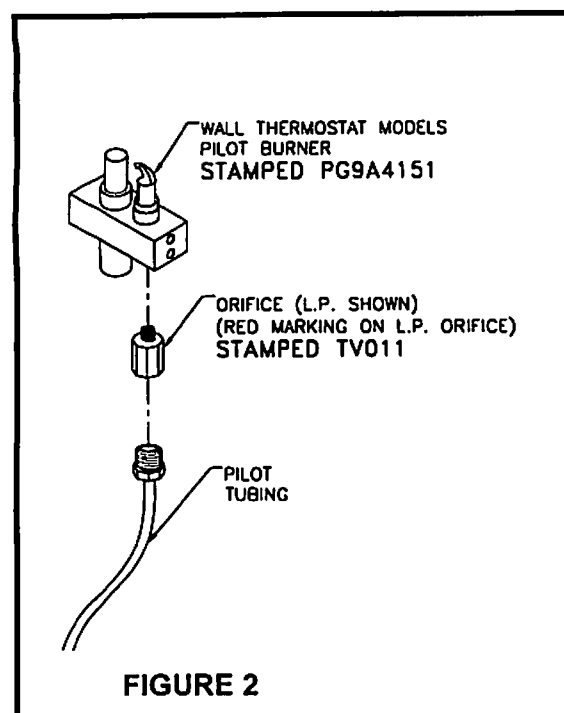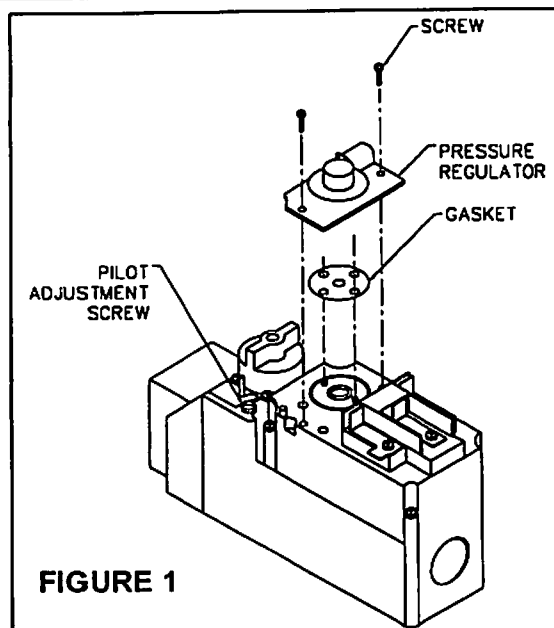


KIT NO.	MODEL NO. ON RATING PLATE*	TO BE USED ON CONVERSION LABEL			
		NEW MODEL NO.	NEW INPUT BTU/HR	NEW HEATING CAPACITY BTU/HR	NEW ORIFICE SIZE
8921	4505622	4505621	45,000	42,000	#45 49
8922	6005622	6005621	60,000	42,000	#45

IMPORTANT: LABEL PLACEMENT

After conversion is completed, the large conversion label provided in this kit must be filled out completely (using chart information). Attach small conversion label to gas valve, and attach large data conversion label to inside of casing door next to rating plate. Remove "Natural Gas" tag from burner and replace with "Liquid Propane Gas" tag provided with this kit. This is necessary to provide information for future servicing. Failure to do so could result in property damage, personal injury or death.

FIGURE 4

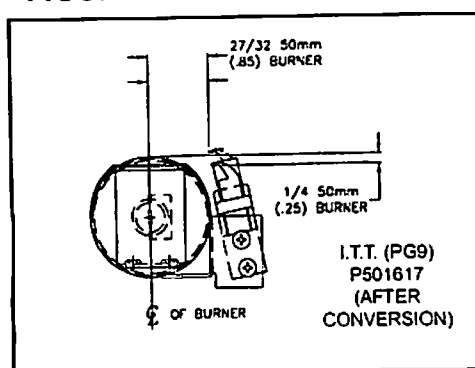

Refer to the Lighting and Operating Instruction Plate located in control area of furnace for instructions on lighting the burner.

WARNING

Any adjustments must be performed by a qualified service technician only. Improper adjustments could result in property damage, personal injury or death.



The following information is provided for use by a qualified service technician.

With main burner in operation, check all pipe connections, pilot gas tubing and around pressure regulator for gas leaks with a rich soap and water solution. Bubbles indicate gas leakage. Never use a match or open flame to test for leaks. Correct even the slightest leak at once before using furnace.

ADJUST PILOT BURNER

NOTE: Pilot gas may need adjustment depending on inlet pressure, increase or decrease to obtain proper setting.

Pilot flame should surround 3/8 inch to 1/2 inch of the thermocouple or generator tip. To adjust, if needed, remove pilot adjustment cap (do not lose gasket).

1. Remove screw cover over pilot adjusting screw.
2. Insert small screwdriver. Adjust flame as needed. Turn screw counterclockwise  to increase flame or clockwise  to decrease flame.
3. Turn thermostat to highest setting. Main burner should light quickly and smoothly. Turn thermostat to lowest setting. Main burner should go out. Pilot should remain lit.
4. Replace screw cover over pilot adjusting screw.

WARNING

DANGER OF PROPERTY DAMAGE, BODILY INJURY OR DEATH.

Liquid Petroleum (L.P.) is heavier than air and it will settle in any low area, including open depressions, and it will remain there unless area is ventilated. Never attempt startup of unit before thoroughly ventilating area.



WARNING

The surface of the furnace is hot during operation. Keep children, clothing, furniture and flammable material away from it.

Do not store or use gasoline or other flammable liquids or vapors near the furnace.

CHECK GAS PRESSURE

The minimum inlet pressure in the gas supply pipe should be 11.0" w.c. for Propane Gas. The maximum inlet pressure should never exceed 13" w.c. This should be checked at the 1/8 inch N.P.T. plugged tapping in the supply line with a manometer.

The manifold pressure for this appliance is 10.5" w.c. for Propane Gas. Check with a manometer at the pressure tap on the control valve. To adjust pressure, remove cap from regulator and turn regulator adjustment screw clockwise  to increase and counterclockwise  to decrease pressure.

RATE VERIFICATION

Refer to the Lighting and Operating Instruction Plate located in control area of furnace for instructions on lighting the burner.

1. Make certain there is no gas flow through the meter other than to the appliance being checked. Other appliances must remain off and the pilots extinguished (or their consumption deducted from the meter reading).
2. With gas control knob in "ON" position, cycle main burner on and off several times by means of thermostat to stabilize PRV diaphragm.
3. With second hand on watch, carefully clock gas meter to determine exact rate of gas flow to main burner in cubic feet per hour (see CONVERSION TABLE below).
4. Compare actual input with manufacturer's recommended hourly input stamped on rating plate. Convert BTU per hour input rating to cubic feet of gas per hour (cfh) by using the following formula.

Where as:



PRV = Pressure
Regulator Valve

MJ = Megajoule

m3 = Metric Cube

$$\frac{\text{Input Rating in BTU per Hour}}{\text{BTU Content of Gas per cu ft}} = \text{Cubic Feet of Gas per Hour}$$

$$\frac{\text{Input Rating in MJ/hr}}{\text{MJ of Gas per m3}} = \text{m3/hr}$$

5. If actual gas flow (cfh) does not conform to manufacturer's recommended input rating (cfh or BTU converted to cfh), a limited adjustment of the PRV may be made. Turn PRV adjusting screw clockwise  to increase or counterclockwise  to decrease gas flow. Burner input must not exceed nameplate rating.
6. Replace cap screw in PRV adjustment stack. Turn gas supply to other appliances back on and re-light all pilots.
7. Place furnace in operation and observe through at least one complete cycle to be sure all controls are operating satisfactorily.

CONVERSION TABLE

This table shows the gas flow rate for measured time per revolution of the ONE CUBIC FOOT DIAL in cubic feet per hour (cfh) and m3/hr.

TIME sec	FLOW cfh	FLOW m3/hr	TIME sec	FLOW cfh	FLOW m3/hr	TIME sec	FLOW cfh	FLOW m3/hr
40	90	2.55	56	64	1.81	88	41	1.16
41	88	2.50	57	63	1.78	92	39	1.10
42	86	2.44	58	62	1.76	96	38	1.08
43	84	2.38	59	61	1.73	100	36	1.02
44	82	2.32	60	60	1.70	105	34	.96
45	80	2.27	62	58	1.64	110	33	.93
46	78	2.21	64	56	1.59	115	31	.88
47	77	2.18	66	54	1.53	120	30	.85
48	75	2.12	68	53	1.50	125	29	.82
49	73	2.07	70	51	1.44	130	28	.79
50	72	2.04	72	50	1.42	135	27	.76
51	71	2.01	74	49	1.39	140	26	.74
52	69	1.95	76	47	1.33	150	24	.68
53	68	1.93	78	46	1.30	160	23	.65
54	67	1.90	80	45	1.27	170	21	.59
55	65	1.84	84	43	1.22	180	20	.57

For 1/2 cu. ft. per revolution of meter dial, multiply flow rate by 2.

For 2 cu. ft. per revolution of meter dial, divide flow rate by 2.

IMPORTANT: LEAVE THESE INSTRUCTIONS WITH THE HOMEOWNER.